


PGS CABLE GLANDS

Cable glands for Heat Trace heating cables

- Up to +80°C Ambient Temperature Range.
- IP66/68 rating.
- Suitable for use in safe and hazardous areas.
- Specifically designed for use with Heat Trace Ltd's range of heating cables.

DESCRIPTION

A range of hazardous area cable glands with flat cable seals type PGS1, PGS3 and PGS5, used for the entry of flat profile heating cables into cabinets boxes, or other enclosures, which are fabricated in the type of protection Increased Safety "e".

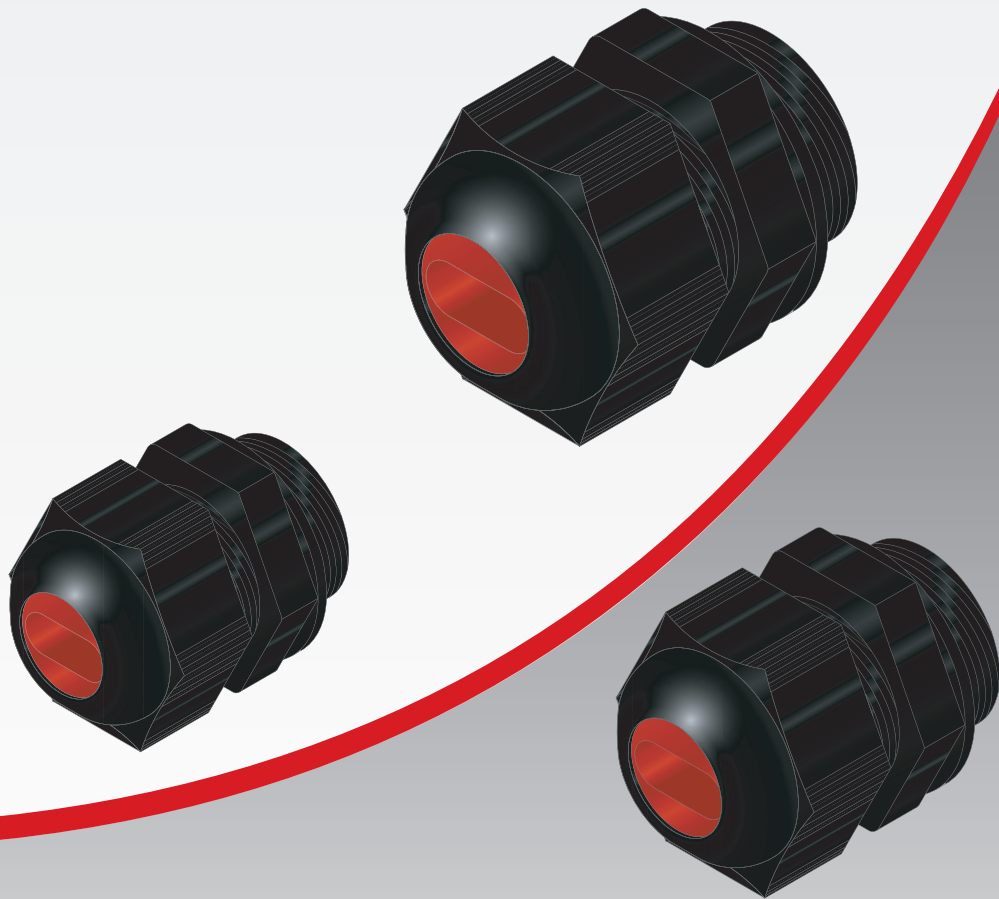


We Believe there is
Strength in Partnership Thermal solutions and services for all applications to all industries.


SPECIFICATION

MINIMUM OPERATING TEMPERATURE


-65°C* (-85°F)



Ref	Dimensions	ATEX Cert	IECEX Cert	EAC Cert*
PGS1	M20(S) x 1.5	IMQ 13 ATEX024X	IECEX IMQ 13.0007X	TC RU C-GB.MIO62.B.06045
Heating Cable Range				
FSM-Cx; MTFJ-Cx; PHT-N				
Ambient Temperature Range: -40°C to +80°C (-40°F to 176°F)				



Ref	Dimensions	ATEX Cert	IECEX Cert	EAC Cert*
PGS3	M20 x 1.5	IMQ 13 ATEX024X	IECEX IMQ 13.0007X	TC RU C-GB.MIO62.B.06045
Heating Cable Range				
FSR-Cx; FSE-Cx; FLVw-Cx; FSS-Cx; FSU-Nx; PHT-NF; AHT				
Ambient Temperature Range: -40°C to +80°C (-40°F to 176°F)				



Ref	Dimensions	ATEX Cert	IECEX Cert	EAC Cert*
PGS5	M25 x 1.5	IMQ 13 ATEX024X	IECEX IMQ 13.0007X	TC RU C-GB.MIO62.B.06045
Heating Cable Range				
FSEw-Cx; FSUw-N				
Ambient Temperature Range: -60°C to +80°C (-85°F to 176°F)				

SPECIAL CONDITIONS FOR SAFE USE

1. The constant power flat-profile heating cables type MTFJ; PHT and AHT are only to be fitted with marked cold section at the beginning of the heating cable with the affiliated cable glands (observe heat conduction).
2. The self-regulating flat profile heating cables type FSS and FSU with the affiliated above mentioned cable glands are only for use in working temperatures up to +80°C.
3. The cable glands type PGS1, PGS3 and PGS5 may be used only for fixed installations of Group II and the user shall ensure adequate securing of the heating cables.
4. The data requirements for the various types are to be met during the installation. The tightening torques should be as shown on the IECEX IMQ 13.0007X examination certificate.
5. A degree of protection - to at least IP66/68 in accordance with EN 60079-0 : 2009 - will be ensured by fitting together the flat heating cables with the affiliated cable gland, according to the instruction manual and the correctly mounted junction box.
6. Only original accessory parts for the cable gland types are to be used for compression nuts and flat cable seals. Substitution of non-original components is not permissible.
7. The cable glands are only suitable for fixed installations. Cables shall be effectively clamped to prevent pulling or twisting.
8. The cable glands with the relevant cables and the plugs shall be used where a protection against risk of mechanical damage is provided.



Heat Trace Ltd, Mere's Edge, Chester Road, Helsby, Frodsham, Cheshire, WA6 0DJ, England.
Tel: +44 (0)1928 726451
www.heat-trace.com Email: info@heat-trace.com



HTUK Services Ltd, Alexandra Building, Wearfield, Sunderland, SR5 2TA
Tel: 0191 5166686 www.HTUK-Services.co.uk Email: enquiries@ht-uk.com

The information given herein, including drawings, illustrations and schematics are intended for illustration purposes only. Heat Trace Ltd makes no warranties as to its accuracy or completeness and disclaims any liability in connection with its use. Users of Heat Trace Ltd products should make their own evaluation to determine the suitability of each such product for specific applications. In no way will Heat Trace Ltd be liable for any damages arising out of the misuse, resale or use of the product.